


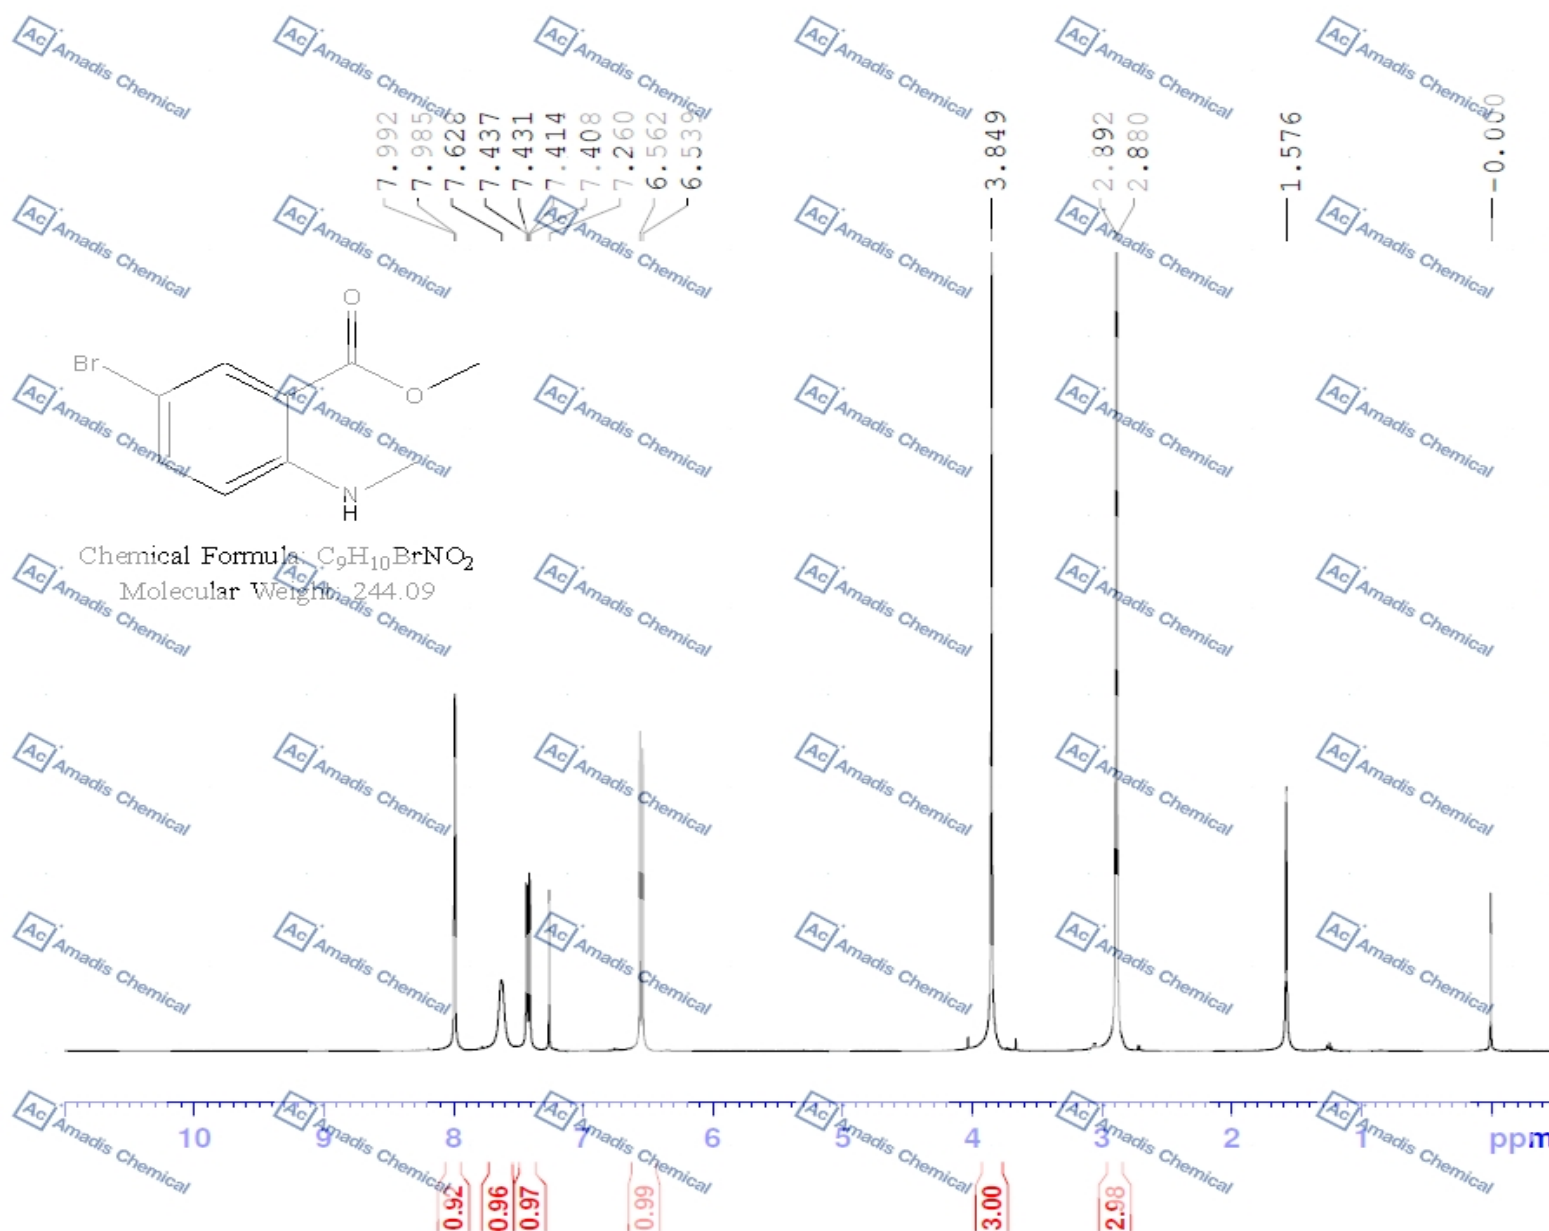

Experiment Data Parameters
NAME 0621-4852
EXPNO 10
PROCNO 1

F2 - Acquisition Parameters
Date_ 20240624
Time 13.32 h
INSTRUM spect
PROBHD Z116098_0490
PULPROG zg30
TD 65536
SOLVENT DMSO
NS 16
DS 2
SWH 8012.820 Hz
FIDRES 0.244522 Hz
AQ 4.0894 sec
RG 111.92
DW 62.400 usec
DE 6.50 usec
TE 299.3 K
D1 1.00000000 sec
TD0 1
SFO1 400.1524709 MHz
NUC1 10
PC 14.69799995 W

F2 - Processing parameters
SI 65536
SF 400.1500097 MHz
WDW EM
SSB 0
LB 0 Hz
GB 0
PC 1.00

*For laboratory or manufacturing use only, not for drug, food and household use.